

Wall Mount Humidity Transmitter Thermostat Humidistat Functions

Independent RH, Temp, and Analog Setpoint Outputs



HT

DESCRIPTION

All HT/HWS Series institutional grade relative humidity/temperature transmitters are designed to meet the rigorous needs of pharmaceutical labs, hospitals, science labs, and other settings that call for precise environmental control. Internal jumpers control access to a feature that allows adjustment of the calibration offsets. The devices can also be made tamper resistant using a jumper to disable keypad programming functions. HT/HWS models are calibrated with NIST traceable calibration equipment.

Analog Output Transmitter

Analog output models feature a keypad to make adjusting humidity and temperature setpoint values easy. They transmit the setpoint values back to a control system by means of dual outputs. A slide-switch allows easy selection of output type, either 4-20mA or 0-5V/0-10VDC signals. Dual outputs enable effortless control of both humidity and temperature in a single, compact sensor.

Setpoint Relay Transmitter

The HT Series setpoint relay models also offer thermostat or humidistat functionality. Two separate relays can be configured to control heating and cooling when in thermostat mode, or humidifying and de-humidifying when in humidistat mode.

HWS models offer the same precise humidity measurement and control as the HT, but without the temperature and thermostat features.

APPLICATIONS

- Hospitals and operating rooms, pharmaceutical labs
- Clean rooms
- Food processing plants
- Environmental testing facilities, and other institutional applications

FEATURES

- Independent RH and T (HT relay) or analog setpoint outputs (HT analog) provide application flexibility
- LCD for local display of readings and setup values
- Offset function adjusts calibration intervals for both RH and T (HT models)
- Switch-selectable 4-20mA or 0-10V/0-5VDC analog outputs
- Multi-point calibration to 1% RH, traceable to NIST
- Replaceable RH sensor element supports field calibration offset...saves time
- Semiconductor temperature sensor can be field calibrated

SPECIFICATIONS



Input Power	15 to 30VDC/24VAC, 100mA max.
Outputs, Analog	Switch-selectable 4-20mA, or 0-10V/0-5VDC (switch affects both outputs)
Outputs, Relay (Relay models only)	2 Form C (SPDT), 1A 30VDC, resistive, 30W max.
HS Element	Digitally profiled thin-film capacitive (32-bit mathematics) U.S. Patent 5,844,138†
Accuracy at 25°C from 10-80% RH* (Multi-point calibration NIST traceable)	±2%, 3%, or 5% models ; ±1% at 20-50% RH on HTA models ±1% at 12-40% RH on HTR models in mA output mode; ±1% at 30% RH on HTR models in voltage output mode
Reset Rate**	24 hours
Stability	±1% @ 20°C (68°F) annually, for two years
Hysteresis	RH: 1.5% (typical), Temp: 1° to 10°F in 1°F increments
Linearity	Included in accuracy spec.
Operating Humidity Range	0-100% RH non-condensing
Temperature Coefficient	± 0.1%RH/°C above or below 25°C (typical)
Operating Temperature Range	10° to 35°C (50° to 95°F)
Temperature Accuracy	±1.0°C (±1.8°F)
Scaling	RH: 0-100%; Temp: 10° to 35°C (50° to 95°F) or 0° to 50°C (32° to 122°F) menu selectable
Calibration Offset	RH: Adjustable ±10% in 0.1% increments; Temp: Adjustable ±10° in 0.1° increments
Setpoint Range	RH: 10-80% in 1% increments; Temp: minimum to full scale in 1°F increments

† The HS sensing element has a 1-year warranty. The element is not a part of the 5-year product warranty.

* Specified accuracy with 24VDC supplied power with rising humidity






**Reset Rate is time required to recover to 50% RH after exposure to 90% RH for 24 hours

One side of transformer secondary is connected to signal common, so an isolation transformer or dedicated power supply may be required.


RTD/Thermistors in wall packages are not compensated for internal heating of product.

APPLICATION/WIRING DIAGRAMS

CONFIGURATION

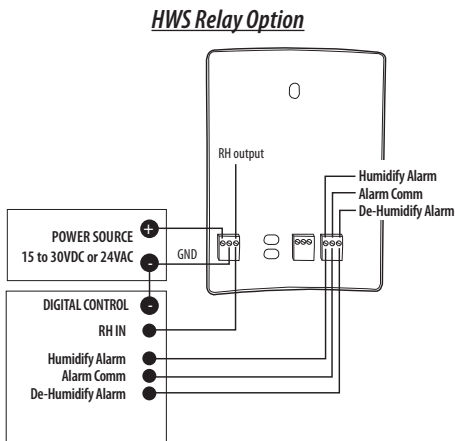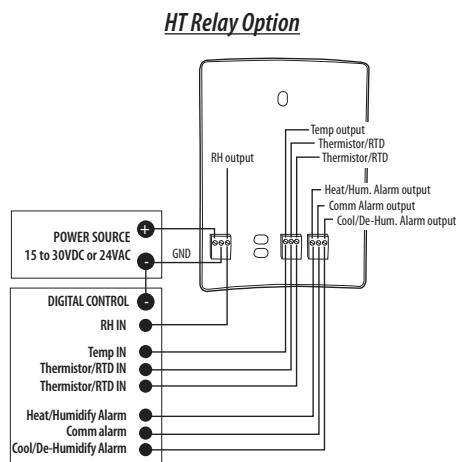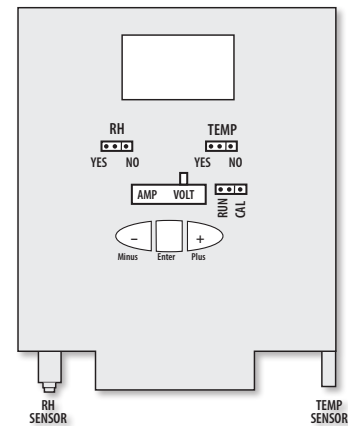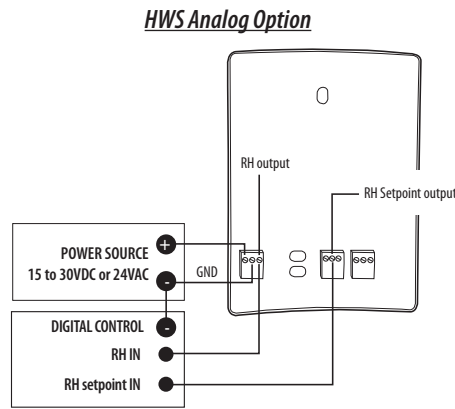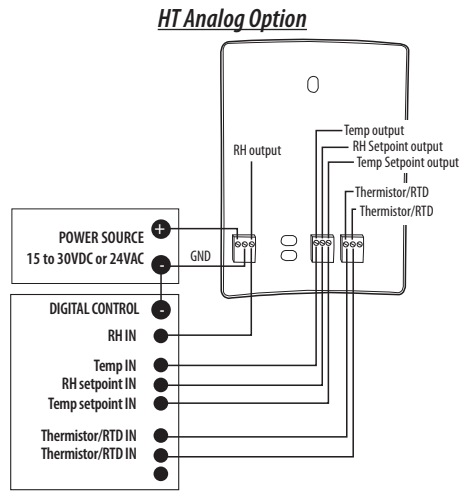

DIMENSIONAL DRAWING

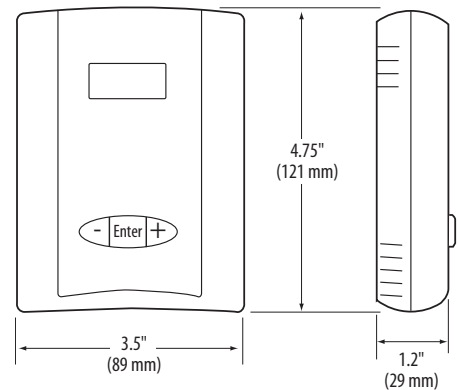

ORDERING INFORMATION



RH/T Combination Device

HT	Accuracy	NIST	Setpoint	Temp Cal Certificate	Option
	<input type="checkbox"/> 1 = 1%	<input type="checkbox"/> N = NIST	<input type="checkbox"/> A = Analog	<input type="checkbox"/> S = CE	<input type="checkbox"/> B = 100R Platinum, RTD
	<input type="checkbox"/> 2 = 2%	<input type="checkbox"/> X = No	<input type="checkbox"/> R = Relay	<input type="checkbox"/> 1 = 1 point Cal Cert	<input type="checkbox"/> C = 1k Platinum, RTD
	<input type="checkbox"/> 3 = 3%			<input type="checkbox"/> 2 = 2 point Cal Cert	<input type="checkbox"/> D = 10k T2, Thermistor
	<input type="checkbox"/> 5 = 5%				<input type="checkbox"/> E = 2.2k, Thermistor
					<input type="checkbox"/> F = 3k, Thermistor
					<input type="checkbox"/> G = 10k CPC Thermistor
					<input type="checkbox"/> H = 10k T3, Thermistor
					<input type="checkbox"/> J = 10k Dale, Thermistor
					<input type="checkbox"/> K = 10k with 11k shunt, Thermistor
					<input type="checkbox"/> M = 20k NTC, Thermistor
					<input type="checkbox"/> N = 1800 ohm TAC, Thermistor
					<input type="checkbox"/> Q = 1uA/C, Linitemp
					<input type="checkbox"/> R = 10k US, Thermistor
					<input type="checkbox"/> S = 10k 3A 221
					<input type="checkbox"/> T = 100k, Thermistor
					<input type="checkbox"/> U = 20k "D", Thermistor
					<input type="checkbox"/> W = 10k T2 high accuracy, Thermistor
					<input type="checkbox"/> Y = 10k T3 high accuracy, Thermistor
					<input type="checkbox"/> Z = 10k E1, Thermistor

Example:

HT 2 N R S 1 H

HT Series devices contain both humidity and temperature transmitter outputs. Optional RTDs and thermistors are available.



ACCESSORIES

Replacement humidity element (HS)

RH Only Device

HWS	Accuracy	NIST	Setpoint
	<input type="checkbox"/> 1 = 1%	<input type="checkbox"/> N = NIST	<input type="checkbox"/> A = Analog
	<input type="checkbox"/> 2 = 2%	<input type="checkbox"/> X = No	<input type="checkbox"/> R = Relay
	<input type="checkbox"/> 3 = 3%		<input type="checkbox"/> S = CE
	<input type="checkbox"/> 5 = 5%		

Example:

HWS 2 N R S