


# V123

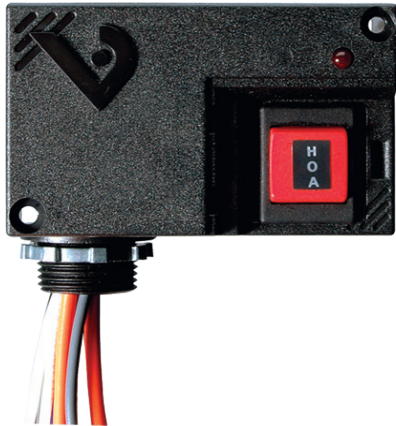

# V123

## 20A SPST Enclosed Relay With Digital HOA Monitor

### Installer's Specifications

Operating Temperature	-40° to 60°C (-40° to 131°F)
Operating Humidity	10-90% RH, non-condensing
Expected Relay Life	Electrical (@ rated current) 100,000 cycles; Mechanical (unpowered) 10,000,000 cycles
Relay Status	LED ON=energized
<b>Wire Specifications:</b>	
Lead Length	14"(356mm) min.
Gauge	UL1015; Coil: 18AWG; Contacts: 12AWG; HOA monitoring wires: 16AWG
Insulation Class	277VAC RMS
<b>Digital Monitor Maximums:</b>	
Dry Circuit Contact Rating (Max.)	24VAC/DC@100mA
Agency Approvals	UL 508 enclosed device listing, pollution degree 2

## **⚠ DANGER ⚡**

### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Follow safe electrical work practices. See NFPA 70E in the USA, or applicable local codes.
- This equipment must only be installed and serviced by qualified electrical personnel.
- Read, understand and follow the instructions before installing this product.
- Turn off all power supplying equipment before working on or inside the equipment.
- Use a properly rated voltage sensing device to confirm power is off.  
**DO NOT DEPEND ON THIS PRODUCT FOR VOLTAGE INDICATION**

**Failure to follow these instructions will result in death or serious injury.**

## NOTICE

- This product is not intended for life or safety applications.
- Do not install this product in hazardous or classified locations.
- The installer is responsible for conformance to all applicable codes.
- Mount this product inside a suitable fire and electrical enclosure.

## INSTALLATION


Disconnect and lock out all power sources before beginning the installation.

1. Using the threaded nipple, connect the relay to the desired enclosure through a knock out hole.
2. Secure with the conduit nut provided.
3. Connect coil wires:
  - Choose the coil common lead (white with yellow stripe) and connect it to the common (-) source termination point.
  - Choose either the low voltage (10-30VAC/DC, white with blue stripe) or high voltage (120VAC, white with black stripe) lead, depending on the application requirements, and connect it to the (+) source termination point.\*


Note: When connecting the control side of this device (#18 wires) to power line circuits, provide currenting limiting at 7 amps max.
4. Connect relay contacts:
  - Choose the relay common wire (yellow) and connect to the switched load.
  - Choose the relay N.O. (orange) and/or\* N.C. (blue) lead and connect to the switched load.
5. Connect digital HOA monitor wires:
  - Choose the solid brown and solid grey wires and connect them to two different digital inputs, referencing the violet wire as common.
6. Secure the enclosure and reconnect power.

\* Isolate or insulate all non-terminated wires according to local electrical code requirements, i.e. wire nut.


## DIMENSIONS

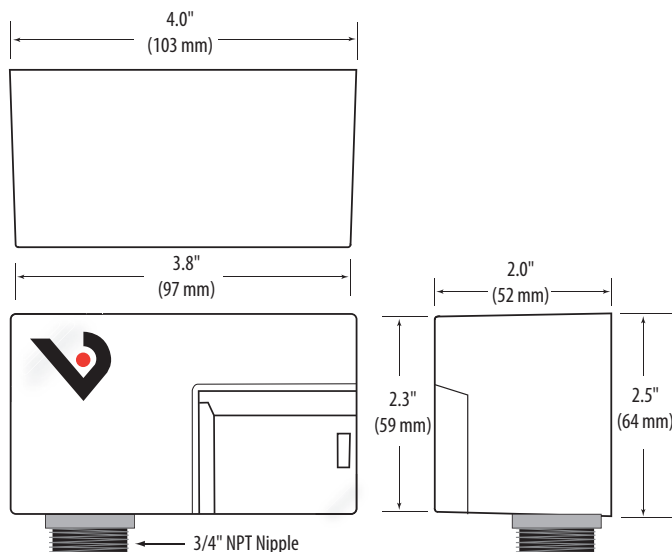

**WIRING COLOR CODES**

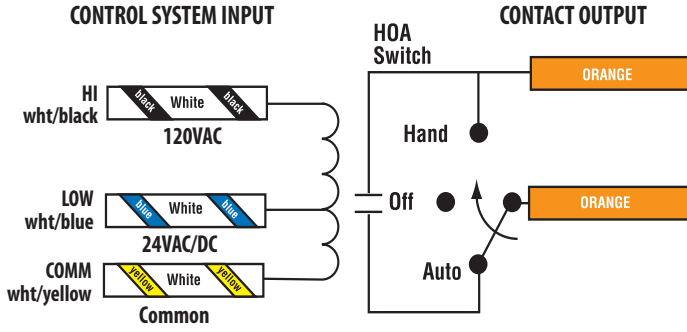


*Digital HOA Position Monitor*

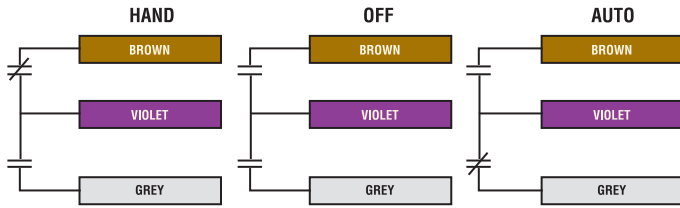


**Switch Positions:**  
 HAND = Brown wire closed to Common  
 OFF = Both wires open to Common  
 AUTO = Grey wire closed to Common

**WIRING EXAMPLE**

*Nipple mount directly to a panel*

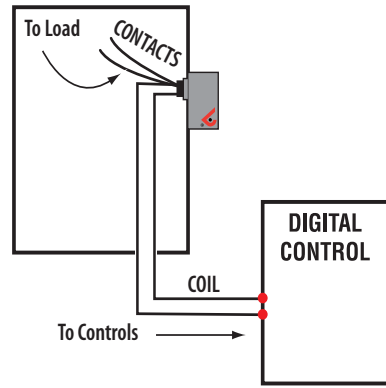

*Nipple mount to a 2x or 4x electrical box*

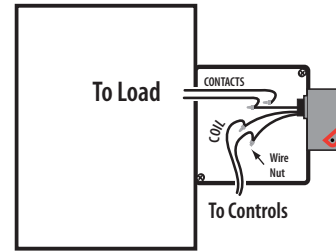


**CONTACT AND COIL SPECIFICATIONS**

TYPICAL COIL PERFORMANCE		
Coil Voltage 24VAC/DC, 120VAC		
Voltage	Coil Current	
	AC	DC
24V.....	75mA.....	32mA
120V.....	22mA	-

CONTACT RATINGS	
Resistive.....	20A(r)@240VAC 8A@28VDC 14A@14VDC
Motor.....	250VAC, 1HP N.O. & N.C.

**HOA POSITIONS**

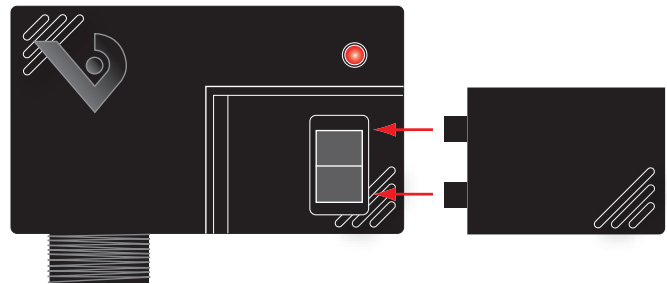

- HAND** Up position: contacts are closed.
- OFF** Middle position: contacts are open.
- AUTO** Down position: control system actuates the contacts.